

INSTALLATION DIAGRAM


Specifications

Rough in dimension: From the floor to the center of bypass approximately 50"

Maximum distance and size for drain line: 50' horizontal, 10" vertical rise, using 1/2" ID drain line

The drain and brine lines should NOT be installed with tubing that can collapse. This will cause the unit to malfunction.

CAUTION: Do NOT connect drain line tubing from control valve to overflow fitting/tubing on brine tank.

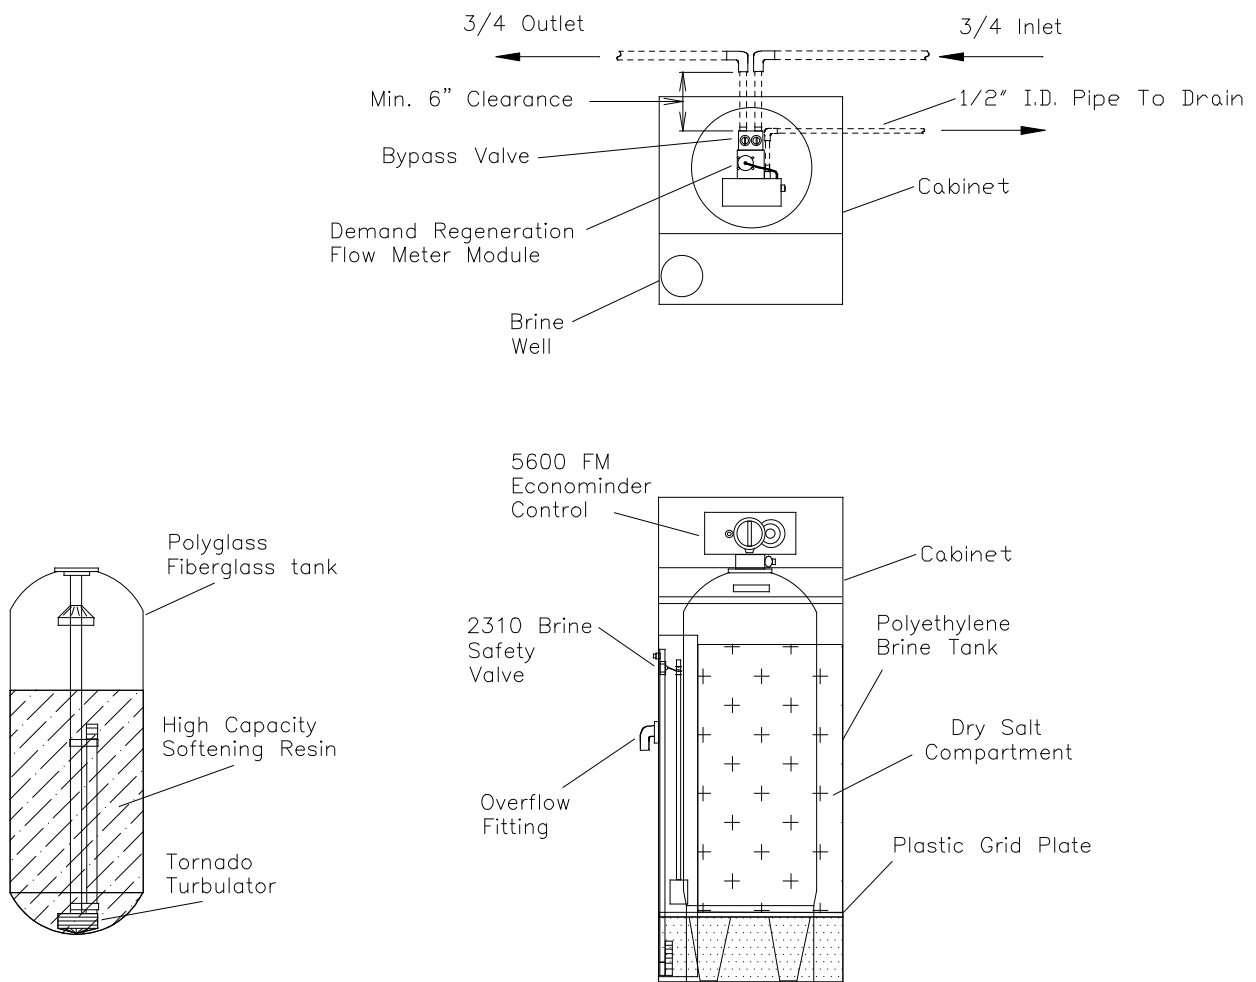

PEERLESS FMC/FMC-M Automatic Water Softener						
Flow Meter Regeneration	Service Pipe	Service Flow Rate	Backwash Rate	Tank Dimensions Inches		Electric Required
Model Number	Size Inches	Gallons Per Minute	Gallons Per Minute	Softener Dimensions	Brine Tank Dimensions	60 Hz
20 FMC/FMC-M	3/4	6.0	2.0	8" X 35"	15" X 26"	120VAC
30 FMC/FMC-M	3/4	8.3	3.0	10" X 35"	15" X 26"	120VAC